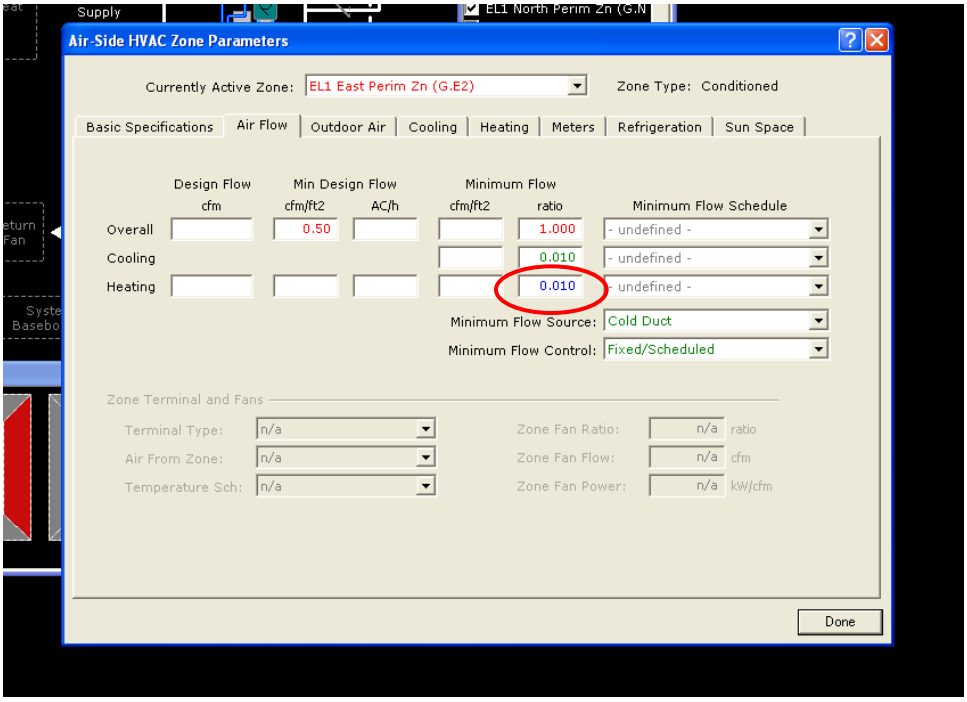
Supply
EL1 North Perim Zn (G.N
Air-Side HVAC Zone Parameters
Currently Active Zone: EL1 East Perim Zn (G.E2)
Zone Type: Conditioned
Basic Specifications
Air Flow
Outdoor Air
Cooling
Heating
Meters
Refrigeration
Sun Space
Design Flow
cfm
Min Design Flow
cfm/ft2
AC/h
Minimum Flow
cfm/ft2
ratio
Minimum Flow Schedule
Overall
0.50
1.000
- undefined -
Cooling
0.010
- undefined -
Heating
0.010
- undefined -
Minimum Flow Source: Cold Duct
Minimum Flow Control: Fixed/Scheduled
Zone Terminal and Fans
Terminal Type: n/a
Air From Zone: n/a
Temperature Sch: n/a
Zone Fan Ratio: n/a ratio
Zone Fan Flow: n/a cfm
Zone Fan Power: n/a kW/cfm
Done

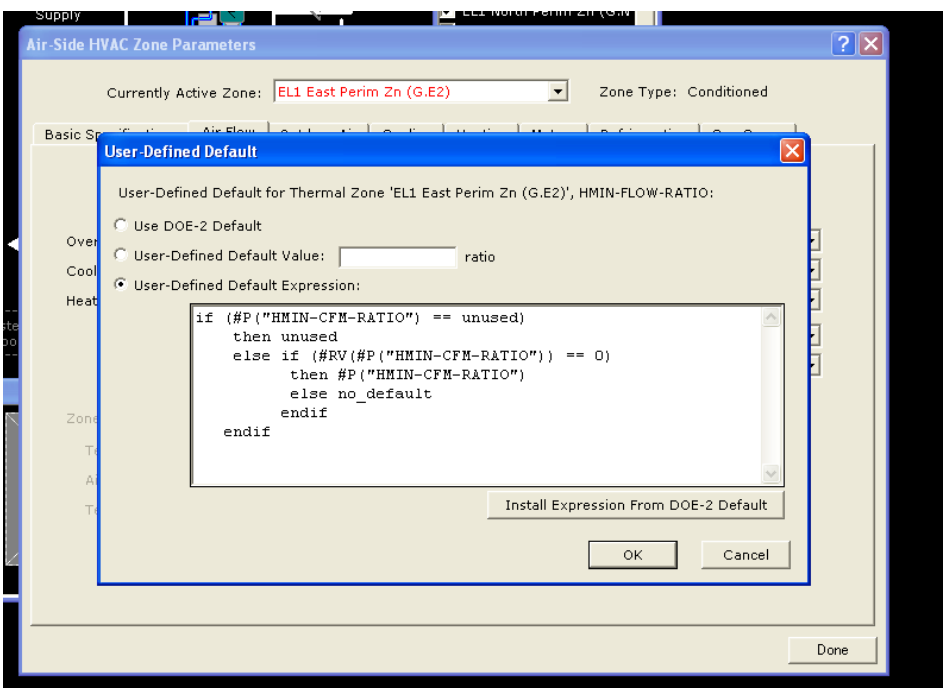
Supply
Air-Side HVAC Zone Parameters
Currently Active Zone: EL1 East Perim Zn (G.E2)
Zone Type: Conditioned
User-Defined Default
User-Defined Default for Thermal Zone 'EL1 East Perim Zn (G.E2)', HMIN-FLOW-RATIO:
Use DOE-2 Default
User-Defined Default Value: ratio
User-Defined Default Expression:
if (#P("HMIN-CFM-RATIO") == unused)
then unused
else if (#RV(#P("HMIN-CFM-RATIO")) == 0)
then #P("HMIN-CFM-RATIO")
else no_default
endif
endif
Install Expression From DOE-2 Default
OK
Cancel
Done