


- ① { DX cooling - Baseline
 Indirect/direct - proposed.

- ② { only cooling
 (No Heating)

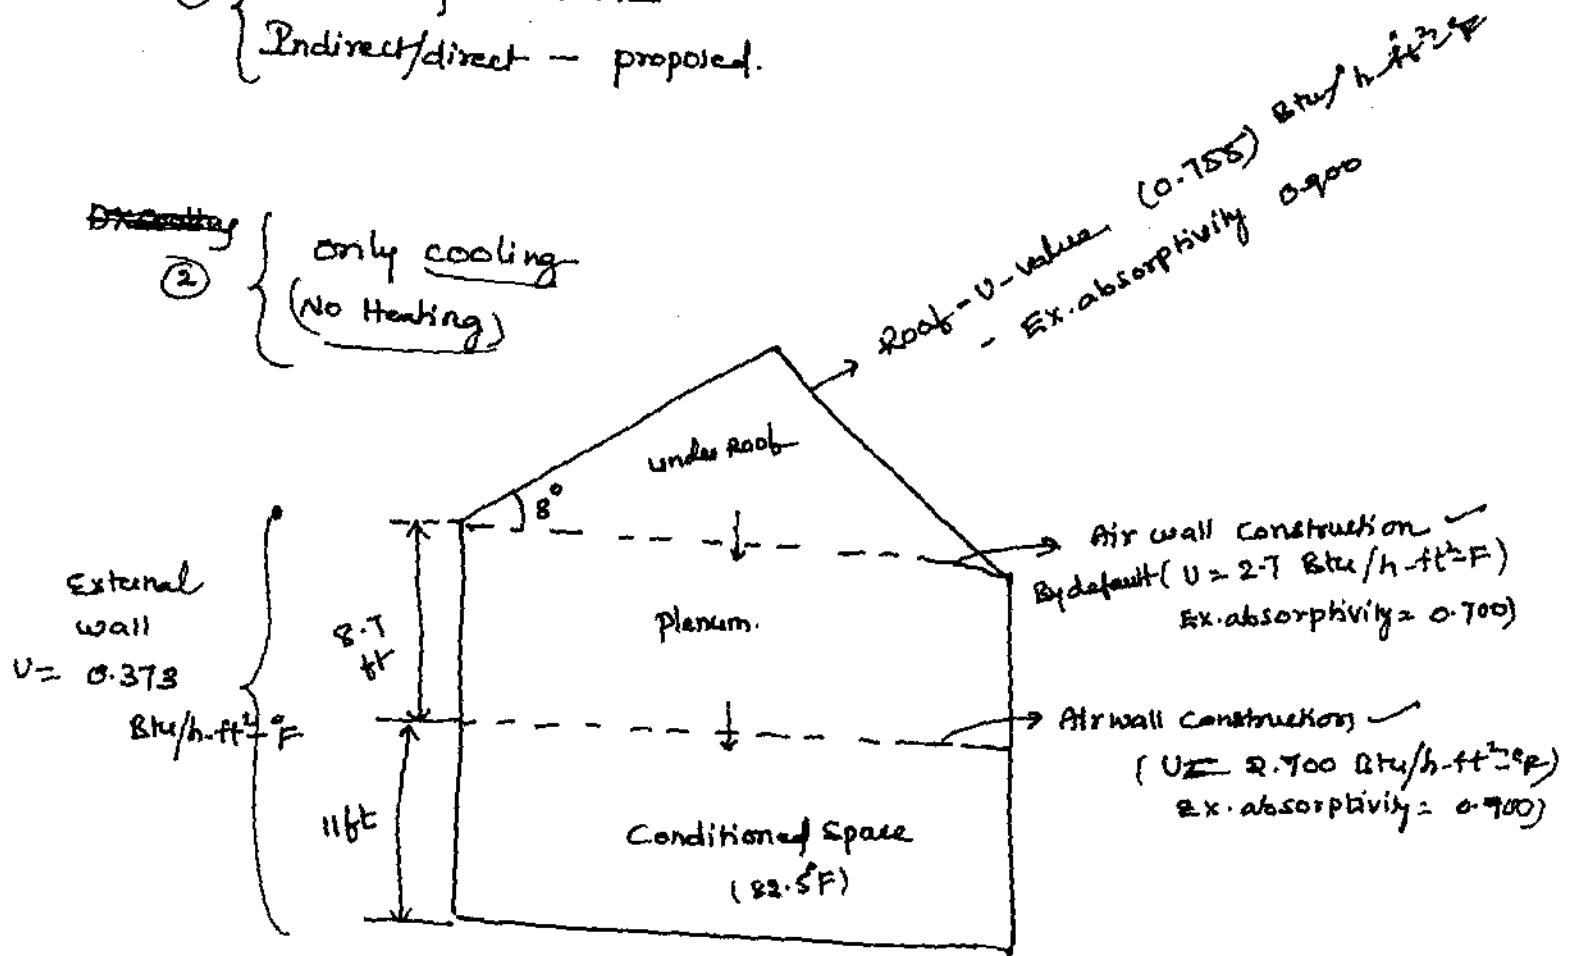

- Total ^{Floor} Area = 39197 ft²
- Conditioned space ^{design} temperature = 82.5°F (28°C)
- Conditioned space is open to roof.
- Space above conditioned presently assumed as plenum. (Return

Classifications :: (air path), (air) time

- ∴ 1) plenum space temperature ? (in space properties)
- 2) Under roof space temperature (in space properties)
- 3) plenum ^{and under roof} design temperature (in zone properties (Indoor design temp))
- 4)